





# **SITE DEVELOPMENT PLAN**

SCALE: 1:4000





PORT OF  
CAGAYAN DE ORO  
MISAMIS ORIENTAL

TITLE:	<b>Supply of Materials, Labor, and Equipment for the Maintenance of Floodlight Tower at Block 13 (MPF-MOC-12-2025)</b>			SHEET NO.
LOCATION:	PORT OF CAGAYAN DE ORO			SHEET CONTENTS
PREPARED BY:  GABRIEL D. MONBONERO Senior Engineer A	CHECKED BY & SUBMITTED BY:  MARC M. AVELLANA Supervising Engineer A	RECOMMENDING APPROVAL:  ANTONIO M. TORCINO, JR. Acting ESD Manager	APPROVED:  FERNANDO B. MAPALO, JR. Acting Port Manager	SITE DEVELOPMENT PLAN
				<div style="border: 1px solid black; border-radius: 50%; width: 40px; height: 40px; display: flex; align-items: center; justify-content: center; margin: 0 auto;"> <div style="text-align: center;">1 2</div> </div>

**FLOODLIGHT SPECS:**

**300W Hi-Power LED Floodlight, Daylight, Water Proof**  
**AC Voltage: 220-240V, 60Hz**  
**24,000 Lumens or Greater**  
**Life time: 15,000 Hours or Greater**  
**Protection Standard: IP65-IP66**  
**Heavy Duty of known Good and High Quality Brand**  
**Material shall be in accordance to electrical codes and standards**

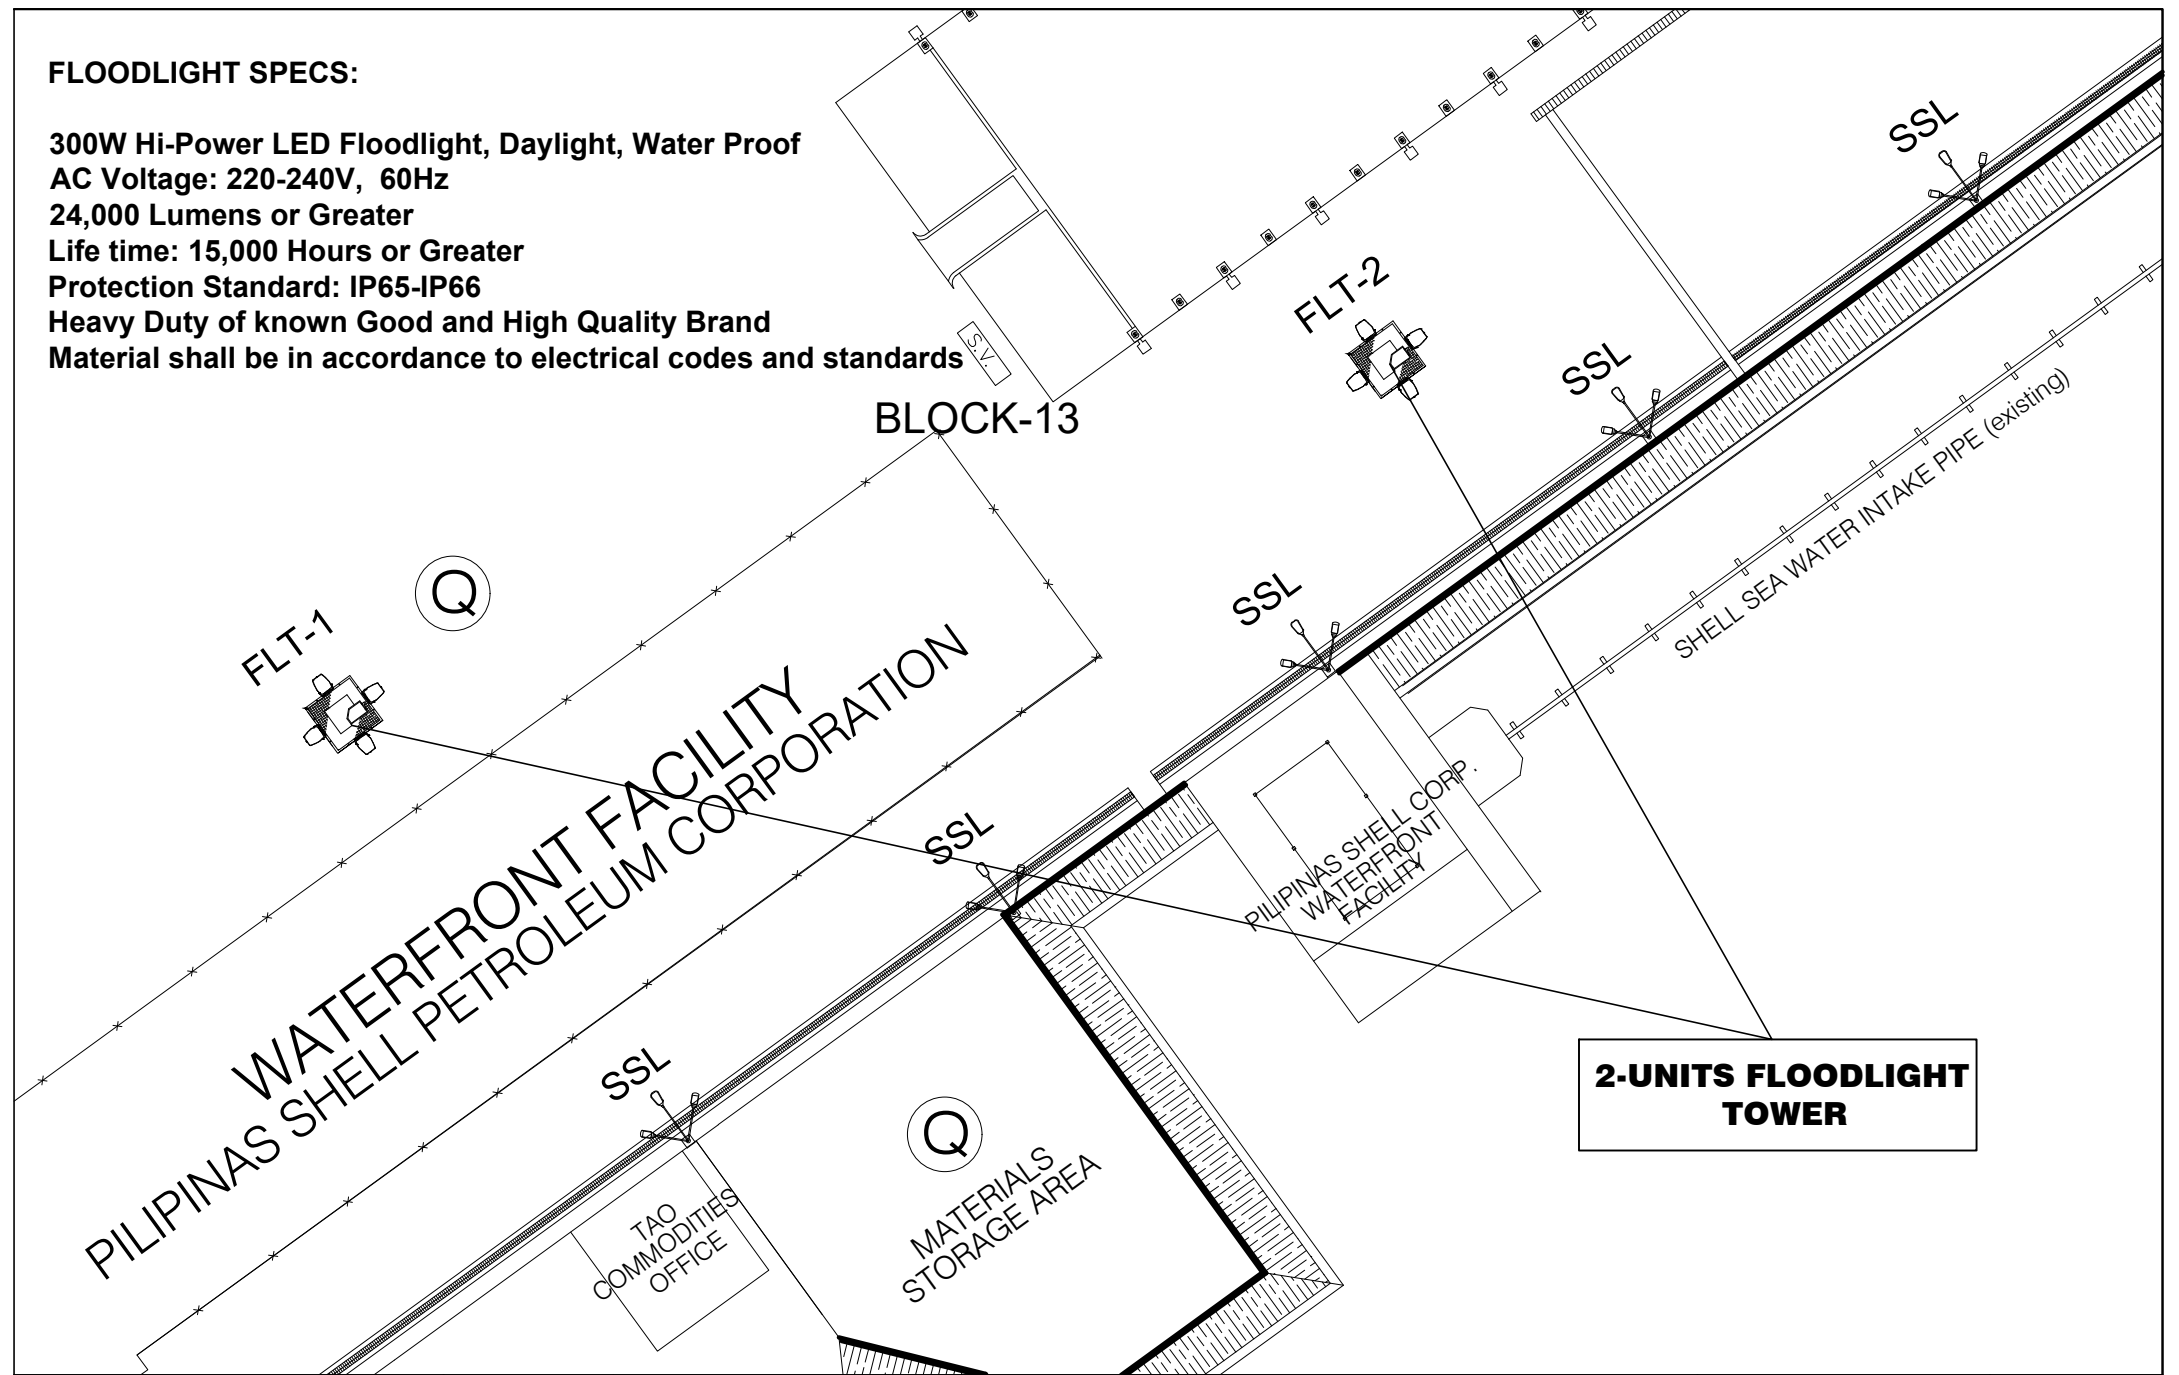

 PORT OF CAGAYAN DE ORO MISAMIS ORIENTAL	TITLE:	Supply of Materials, Labor, and Equipment for the Maintenance of Floodlight Tower at Block 13 (MPF-MOC-12-2025)				SHEET NO.
	LOCATION:	PORT OF CAGAYAN DE ORO				<div>2</div> <div>2</div>
	PREPARED BY:	CHECKED BY & SUBMITTED BY:	RECOMMENDING APPROVAL:	APPROVED:	SHEET CONTENTS	
	GABRIEL T. MONDONEDO Senior Engineer A	MARC M. AVELLANA Supervising Engineer A	ANTONIO M. TORCINO, JR. Acting ESD Manager	FERNANDO B. MAPALO, JR. Acting Port Manager	LAYOUT PLAN AND DETAILS AT BLOCK 13	